



Test Report: DDR-120C-24

120W DC-DC DIN Rail Power Supply

■ DESIGN VERIFY TEST

- Output Function Test
- Input Function Test
- Protection Function Test
- Control Function Test
- Component Stress Test

■ SAFETY & E.M.C. TEST

- Safety Test
- E.M.C. Test

■ RELIABILITY TEST


- ENVIRONMENT TEST

DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE TOLERANCE (Max)	V1: -1%~1%	I/P:33.6VDC /67.2VDC O/P:FULL/ MIN. LOAD Ta:25°C	V1: -0.121%~0.163%
2	LINE REGULATION (Max)	V1: -0.5%~0.5%	I/P: 33.6VDC / 67.2 VDC O/P:FULL LOAD Ta:25°C	V1: -0.029%~0.029%
3	LOAD REGULATION (Max)	V1: -1%~ 1%	I/P:48VDC O/P:FULL ~MIN LOAD Ta:25°C	V1: -0.121%~0.163%
4	OVER/UNDERSHOOT TEST	< +5%	I/P: 48VDC O/P:FULL LOAD Ta:25°C	TEST: 2.1%
5	RIPPLE & NOISE (Max)	V1: 50mVp-p	I/P: 48VDC O/P:FULL LOAD Ta:25°C	V1: 13 mVp-p

high frequency :

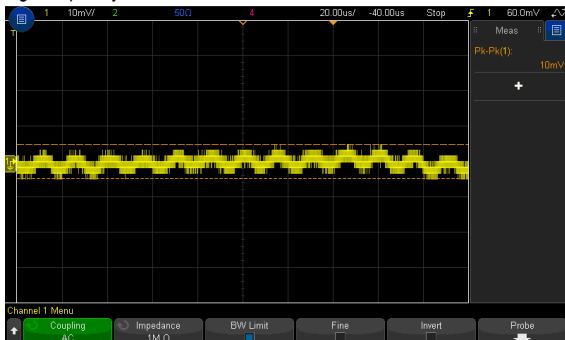


low frequency :

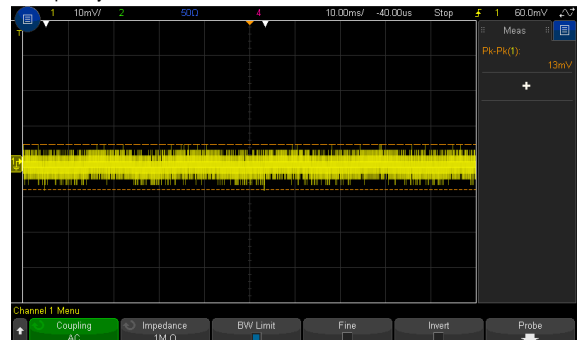

6	SET UP TIME (Max)	48VDC/ 500 ms	I/P: 48VDC O/P:FULL LOAD Ta:25°C	48VDC/ 275 ms
---	-------------------	---------------	--	---------------


INPUT=48VDC @ FULL LOAD

CH1 : Output Voltage CH4 : DC Input Voltage

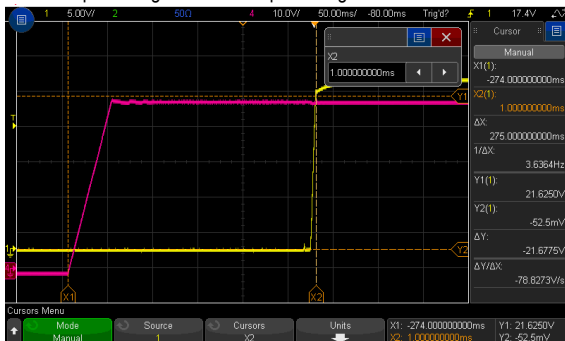

7	RISE TIME (Max)	48VDC/ 60 ms	I/P: 48 VDC O/P:FULL LOAD Ta:25°C	48VDC/ 4.78 ms
---	-----------------	--------------	---	----------------

INPUT=48VDC @ FULL LOAD

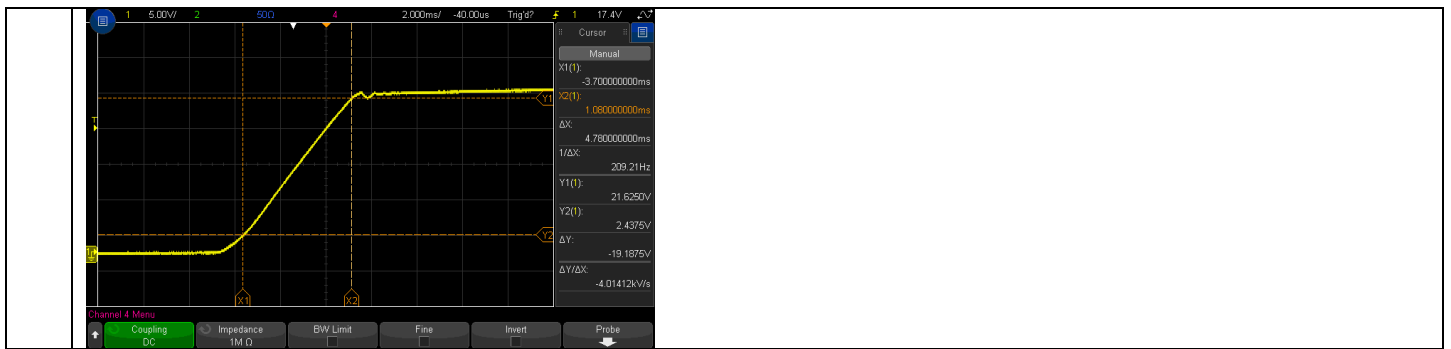

8	HOLD UP TIME (TYP)	48VDC / 6 ms @full load 48VDC / 10 ms@60% load	I/P: 48VDC O/P: FULL LOAD Ta:25°C	48VDC/6.68 ms@full load 48VDC/10.6 ms@60%load
---	--------------------	---	---	--


INPUT=48VDC @ FULL LOAD

CH1 : Output Voltage CH4 : DC Input Voltage




INPUT=48VDC @ 70% LOAD

CH1 : DC Input Voltage CH2 : Output Voltage

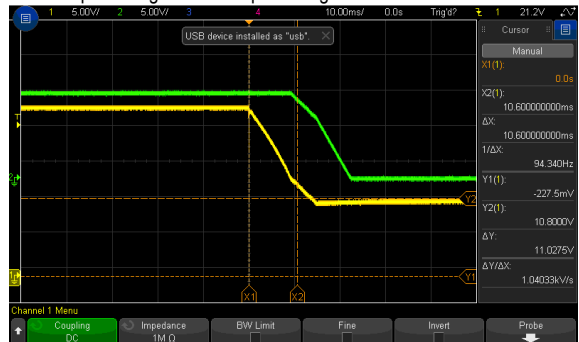


9	DYNAMIC LOAD	V1: 2400 mVp-p	I/P: 48VDC O/P: (1)FULL /MIN LOAD 50%DUTY / 120HZ (2)FULL /MIN LOAD 50%DUTY / 1KHZ Ta:25°C	1050mVp-p 1160mVp-p
---	--------------	----------------	--	------------------------

FULL /MIN LOAD 50%DUTY / 120HZ

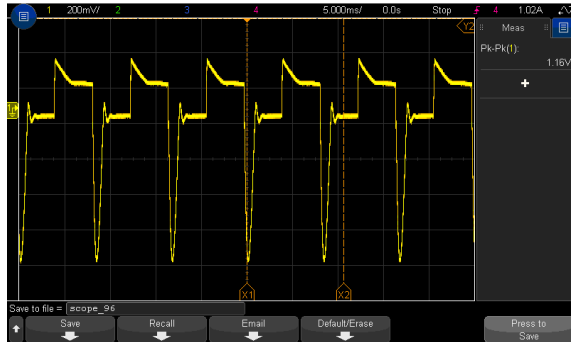

FULL /MIN LOAD 50%DUTY / 1KHZ

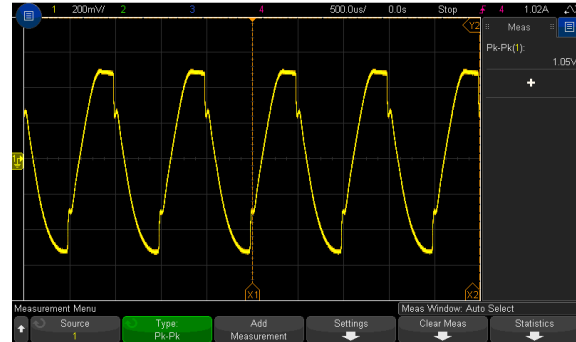

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	33.6VDC~ 67.2VDC	I/P: TESTING O/P: FULL LOAD Ta:25°C	28.63V~67.2 V
			I/P: LOW-LINE-0.2= 33.4 V HIGH-LINE+3V= 70.2 V O/P: FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec . OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	TEST: OK

2	INPUT CURRENT(TYP)	48VDC/ 2.8 A	I/P: 48VDC O/P:FULL LOAD Ta:25°C	I = 2.719 A/48 VDC																						
3	EFFICIENCY(TYP)	91 %	I/P: 48VDC O/P:FULL LOAD Ta:25°C	91.51%																						
<p>EFFICIENCY vs LOAD</p> <table border="1"> <caption>Efficiency vs Load Data (24VDC)</caption> <thead> <tr> <th>Load (%)</th> <th>Efficiency (%)</th> </tr> </thead> <tbody> <tr><td>10%</td><td>81</td></tr> <tr><td>20%</td><td>88</td></tr> <tr><td>30%</td><td>90</td></tr> <tr><td>40%</td><td>91</td></tr> <tr><td>50%</td><td>91</td></tr> <tr><td>60%</td><td>91</td></tr> <tr><td>70%</td><td>91</td></tr> <tr><td>80%</td><td>91</td></tr> <tr><td>90%</td><td>91</td></tr> <tr><td>100%</td><td>91</td></tr> </tbody> </table>					Load (%)	Efficiency (%)	10%	81	20%	88	30%	90	40%	91	50%	91	60%	91	70%	91	80%	91	90%	91	100%	91
Load (%)	Efficiency (%)																									
10%	81																									
20%	88																									
30%	90																									
40%	91																									
50%	91																									
60%	91																									
70%	91																									
80%	91																									
90%	91																									
100%	91																									
4	INRUSH CURRENT(TYP)	48VDC/ 5 A COLD START	I/P: 48VDC O/P:FULL LOAD Ta:25°C	I =3.75A/48 VDC																						
<p>INPUT=48VDC @ FULL LOAD</p>																										

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	105%~135%RATED OUTPUT POWER	I/P: 67.2VDC I/P: 48VDC I/P: 33.6VDC O/P:TESTING Ta:25°C	123.6%/ 67.2VDC 124.99%/48VDC 126.68%/ 33.6VDC PROTECTION TYPE : Normally works within 105~150% rated output power for more than 3 seconds and then constant current protection with auto-recovery >150% rated power ,constant current limiting with auto-recovery
2	OVER VOLTAGE PROTECTION	CH: 28.8 V~ 33.6 V	I/P: 67.2VDC I/P: 48VDC I/P: 33.6VDC O/P:MIN LOAD Ta:25°C	31.5V/67.2VDC 31.5V/48 VDC 31V/ 33.6 VDC PROTECTION TYPE : Shut down O/P voltage,re-power on to recover
3	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 67.2 VDC O/P: FULL LOAD Ta:25°C	NO DAMAGE PROTECTION TYPE : Normally works within 105~150% rated output power for more than 3 seconds and then constant current protection with auto-recovery >150% rated power ,constant current limiting with auto-recovery



4	INPUT REVERSE	POWER OK	I/P:67.2 VDC O/P: NO LOAD Ta:25°C	NO DAMAGE
---	---------------	----------	---	-----------

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor (D to S) or (C to E) Peak Voltage	Q 5 Rated : 200 V Q 6 Rated : 200 V	I/P:High-Line +3V =70.2V DC ON/OFF VDS: O/P: (1)Full Load (2)Output Short (3)Full Load Continue Ta:25°C	Q5 VDS: (1) 114.6V (2) 88.8V (3) 108.9V Q6 VDS: (1)108.1 V (2) 74.3V (3) 96.9V
4	Diode Peak Voltage	Q100 Rated : 200V Q101 Rated : 150V	I/P:High-Line +3V =70.2 V DC ON/OFF O/P: (1)Full Load (2)Output Short (3)Full Load Continue Ta:25°C	Q100: VDS: (1) 101.7V (2)21.8 V (3) 46.4V Q101 VDS (1) 116.2V (2) 114.6V (3) 112.1V
5	Input Capacitor Voltage	C5 Rated: : 330 μ / 80 V	I/P:High-Line +3V =70.2 V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change (4)Full load continue Ta:25°C	C5: (1) 71.7V (2) 71.7V (3) 71.3V (4) 70.9V
6	Control IC Voltage Test	PWM IC U1 Rated -0.3V~16V	I/P:High-Line +3V =70.2 V DC ON/OFF O/P (1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. Ta:25°C	U1: (1) 14.6 V (2) 14.6 V (3) 14.8 V (4) 14.8V

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P:4KVDC/min I/P-FG:2.5 KVDC/min O/P-FG:2.5 KVDC/min	I/P-O/P: 4.4KVDC/min I/P-FG: 3 KVDC/min O/P-FG:3KVDC/min Ta:25°C	I/P-O/P: 0 mA I/P-FG: 0 mA O/P-FG: 0 mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P: 9999MΩ I/P-FG: 9999 MΩ O/P-FG:9999 MΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	10mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	RADIATION	<input checked="" type="checkbox"/> EN55032 <input type="checkbox"/> EN55011 <input type="checkbox"/> CLASS A <input checked="" type="checkbox"/> CLASS B	I/P: 48 VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> PASS <input type="checkbox"/> FAIL Test by certified Lab



2	CONDUCTION	<input checked="" type="checkbox"/> EN55032 <input type="checkbox"/> EN55011 <input type="checkbox"/> CLASS A <input checked="" type="checkbox"/> CLASS B	I/P:48 VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> PASS <input type="checkbox"/> FAIL Test by certified Lab
3	E.S.D	EN61000-4-2 <input type="checkbox"/> Din rail Model : AIR: 8KV / Contact: 6KV	I/P: 48 VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
4	E.F.T	EN61000-4-4 <input type="checkbox"/> INDUSTRY INPUT: 2KV	I/P:48 VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
5	SURGE	IEC61000-4-5 <input type="checkbox"/> INDUSTRY L-N :1KV L,N-FG:2KV	I/P:48 VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
6	Test by certified Lab & Test Report Prepare			

RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																								
1	TEMPERATURE RISE TEST	MODEL : DDR-120C-12 1. ROOM AMBIENT BURN-IN : 1 HRS I/P : 48VDC O/P : FULL LOAD Ta= 23.1 °C 2. HIGH AMBIENT BURN-IN : 1 HRS I/P : 48VDC O/P : FULL LOAD Ta= 50.8 °C																																																																																										
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 23.1 °C</th> <th>HIGH AMBIENT Ta= 50.8 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF1</td><td>50.5°C</td><td>81.6°C</td></tr> <tr><td>2</td><td>LF2</td><td>46.6°C</td><td>77.3°C</td></tr> <tr><td>3</td><td>LF100</td><td>60.5°C</td><td>90.7°C</td></tr> <tr><td>4</td><td>T1</td><td>58.2°C</td><td>88.4°C</td></tr> <tr><td>5</td><td>T2</td><td>53.2°C</td><td>83.5°C</td></tr> <tr><td>6</td><td>Q1</td><td>48.1°C</td><td>79.3°C</td></tr> <tr><td>7</td><td>Q2</td><td>48.3°C</td><td>79.5°C</td></tr> <tr><td>8</td><td>Q5</td><td>56.3°C</td><td>88.7°C</td></tr> <tr><td>9</td><td>Q6</td><td>54.6°C</td><td>85.3°C</td></tr> <tr><td>10</td><td>Q100</td><td>61.4°C</td><td>94.1°C</td></tr> <tr><td>11</td><td>Q101</td><td>63.6°C</td><td>95.9°C</td></tr> <tr><td>12</td><td>L100</td><td>64.8°C</td><td>96.0°C</td></tr> <tr><td>13</td><td>C1</td><td>49.7°C</td><td>80.7°C</td></tr> <tr><td>14</td><td>C5</td><td>47.2°C</td><td>78.6°C</td></tr> <tr><td>15</td><td>C6</td><td>48.3°C</td><td>78.4°C</td></tr> <tr><td>16</td><td>C7</td><td>51.6°C</td><td>81.6°C</td></tr> <tr><td>17</td><td>C101</td><td>61.6°C</td><td>91.7°C</td></tr> <tr><td>18</td><td>C102</td><td>61.1°C</td><td>91.7°C</td></tr> <tr><td>19</td><td>C104</td><td>56.3°C</td><td>85.8°C</td></tr> <tr><td>20</td><td>C106</td><td>56.0°C</td><td>87.3°C</td></tr> <tr><td>21</td><td>ZNR1</td><td>44.0°C</td><td>74.6°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 23.1 °C	HIGH AMBIENT Ta= 50.8 °C	1	LF1	50.5°C	81.6°C	2	LF2	46.6°C	77.3°C	3	LF100	60.5°C	90.7°C	4	T1	58.2°C	88.4°C	5	T2	53.2°C	83.5°C	6	Q1	48.1°C	79.3°C	7	Q2	48.3°C	79.5°C	8	Q5	56.3°C	88.7°C	9	Q6	54.6°C	85.3°C	10	Q100	61.4°C	94.1°C	11	Q101	63.6°C	95.9°C	12	L100	64.8°C	96.0°C	13	C1	49.7°C	80.7°C	14	C5	47.2°C	78.6°C	15	C6	48.3°C	78.4°C	16	C7	51.6°C	81.6°C	17	C101	61.6°C	91.7°C	18	C102	61.1°C	91.7°C	19	C104	56.3°C	85.8°C	20	C106	56.0°C	87.3°C	21	ZNR1	44.0°C	74.6°C
NO	Position	ROOM AMBIENT Ta= 23.1 °C	HIGH AMBIENT Ta= 50.8 °C																																																																																									
1	LF1	50.5°C	81.6°C																																																																																									
2	LF2	46.6°C	77.3°C																																																																																									
3	LF100	60.5°C	90.7°C																																																																																									
4	T1	58.2°C	88.4°C																																																																																									
5	T2	53.2°C	83.5°C																																																																																									
6	Q1	48.1°C	79.3°C																																																																																									
7	Q2	48.3°C	79.5°C																																																																																									
8	Q5	56.3°C	88.7°C																																																																																									
9	Q6	54.6°C	85.3°C																																																																																									
10	Q100	61.4°C	94.1°C																																																																																									
11	Q101	63.6°C	95.9°C																																																																																									
12	L100	64.8°C	96.0°C																																																																																									
13	C1	49.7°C	80.7°C																																																																																									
14	C5	47.2°C	78.6°C																																																																																									
15	C6	48.3°C	78.4°C																																																																																									
16	C7	51.6°C	81.6°C																																																																																									
17	C101	61.6°C	91.7°C																																																																																									
18	C102	61.1°C	91.7°C																																																																																									
19	C104	56.3°C	85.8°C																																																																																									
20	C106	56.0°C	87.3°C																																																																																									
21	ZNR1	44.0°C	74.6°C																																																																																									
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 48 VDC O/P : 119 % LOAD Ta : 25°C	TEST : OK																																																																																								



3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 43.2 VDC/ 67.2 VDC O/P : 100 % LOAD Ta= -45 °C	TEST : OK												
4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 55 °C NO DAMAGE	I/P : 70.2 VDC O/P : FULL LOAD Ta= 55 °C HUMIDITY= 95 %R.H	TEST : OK												
5	TEMPERATURE COEFFICIENT	± 0.03 %(0~55°C)	I/P : 48 VDC O/P : FULL LOAD	± 0.003 %(0~55°C)												
6	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : STATIC		TEST : OK												
7	THERMAL SHOCK TEST	1. Thermal shock Temperature : -45°C~ +60°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/Output condition : 48VDC/Full Load DC ON/OFF TEST turn on 3sec ; turn off 1sec@15cycle\ 48VDC/Full Load DC ON@1cycle		TEST : OK												
8	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 5G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C 2 Din Rail <table border="1" style="margin-left: 20px;"> <thead> <tr> <th></th> <th>Displacement</th> <th>Acceleration</th> </tr> </thead> <tbody> <tr> <td>2 (+3/-0) Hz up to 15Hz</td> <td>±2.5mm</td> <td>-----</td> </tr> <tr> <td>15Hz up to 50Hz</td> <td>-----</td> <td>2.3g</td> </tr> <tr> <td>Sweep rate</td> <td colspan="2">Max 1 Octave/minute</td> </tr> </tbody> </table>			Displacement	Acceleration	2 (+3/-0) Hz up to 15Hz	±2.5mm	-----	15Hz up to 50Hz	-----	2.3g	Sweep rate	Max 1 Octave/minute		TEST : OK
	Displacement	Acceleration														
2 (+3/-0) Hz up to 15Hz	±2.5mm	-----														
15Hz up to 50Hz	-----	2.3g														
Sweep rate	Max 1 Octave/minute															
9	CAPACITOR LIFE CYCLE	SUPPOSE C102 IS THE MOST CRITICAL COMPONENT (1) I/P : 48VDC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 48VDC O/P : FULL LOAD Ta= 55 °C LIFE TIME (3) I/P : 48VDC O/P : 75% LOAD Ta= 55 °C LIFE TIME (4) I/P : 48VDC O/P : 50% LOAD Ta= 55 °C LIFE TIME		(1) 150348.4 HRS (2) 21758.8 HRS (3) 50933.8 HRS (4) 120805 HRS												
10	MTBF	Conducted by Parts Stress Analysis Prediction 1769.5K hrs min. Telcordia SR-332 (Bellcore) ; 214.5K hrs min. MIL-HDBK-217F (25°C)														
11	DMTBF/Accelerated Life Test	Demonstration Mean Time Between Failure (Expected Life): Above 30,000 hours @ TA 55°C														

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	LIUTT		WANGDZ

12.10.30 A50-F031