



# Test Report: DDR-120D-48

---

120W DC-DC DIN Rail Power Supply

## ■ DESIGN VERIFY TEST

Output Function Test  
Input Function Test  
Protection Function Test  
Control Function Test  
Component Stress Test

## ■ SAFETY & E.M.C. TEST

Safety Test  
E.M.C. Test

## ■ RELIABILITY TEST


ENVIRONMENT TEST

## DESIGN VERIFY TEST


### OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE TOLERANCE (Max)	V1: -1%~1%	I/P: 86.4VDC /154VDC O/P: FULL/ MIN. LOAD Ta:25°C	V1: -0.15%~0.25%
2	LINE REGULATION (Max)	V1: -0.5%~0.5%	I/P: 86.4VDC / 154 VDC O/P: FULL LOAD Ta:25°C	V1: -0.12%~0.09%
3	LOAD REGULATION (Max)	V1: -1%~1%	I/P: 110VDC O/P: FULL ~MIN LOAD Ta:25°C	V1: -0.15%~0.25%
4	OVER/UNDERSHOOT TEST	< ±5%	I/P: 110 VDC O/P: FULL LOAD Ta:25°C	TEST: 1.2%
5	RIPPLE & NOISE (Max)	V1: 50 mVp-p	I/P: 110 VDC O/P: FULL LOAD Ta:25°C	V1: 14mVp-p

high frequency :

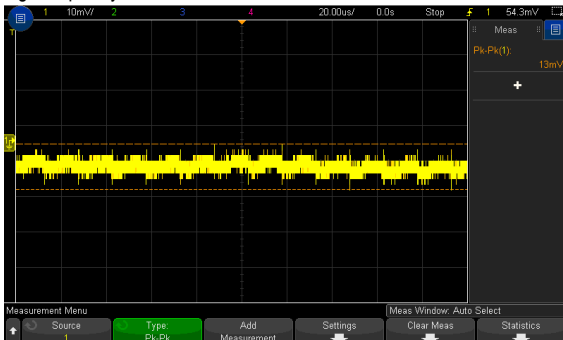


low frequency :

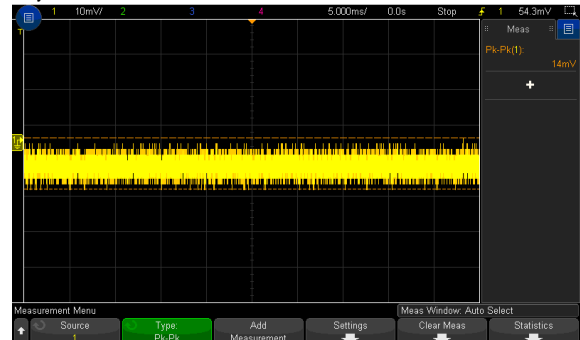

6	SET UP TIME (Max)	110VDC/ 500 ms	I/P: 110VDC O/P: FULL LOAD Ta:25°C	110VDC/302 ms
---	-------------------	----------------	--	---------------


INPUT=110VDC @ FULL LOAD

CH1 : DC Input Voltage CH2 : Output Voltage

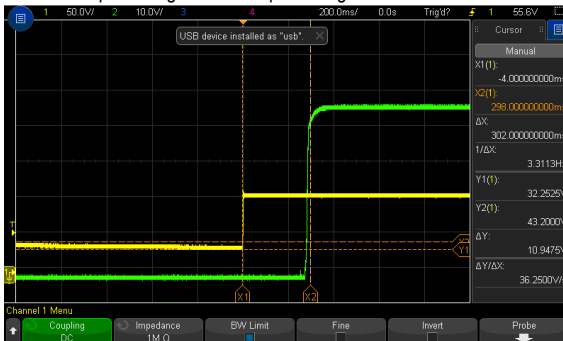

7	RISE TIME (Max)	110VDC/ 60 ms	I/P: 110 VDC O/P: FULL LOAD Ta:25°C	110VDC/ 13.47ms
---	-----------------	---------------	---	-----------------


INPUT=110VDC @ FULL LOAD

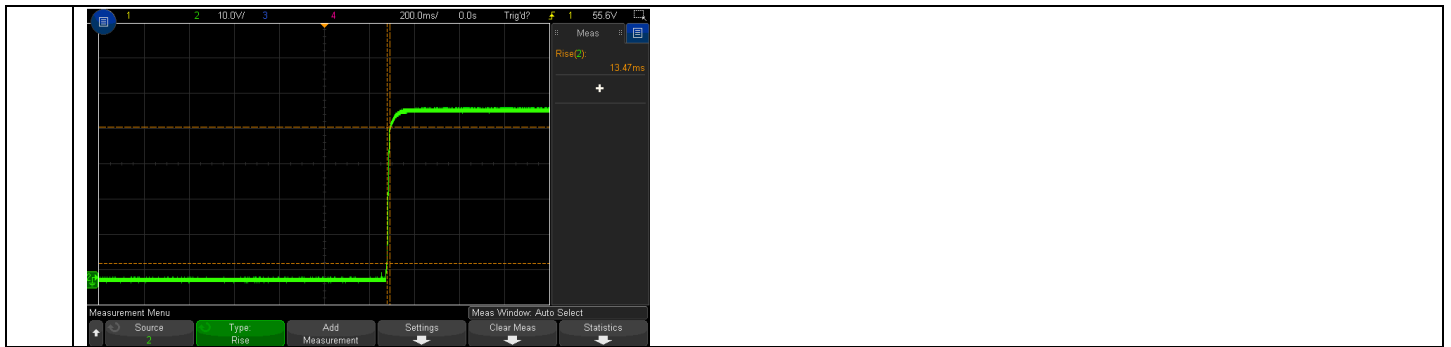

8	HOLD UP TIME (TYP)	110VDC/ 10 ms	I/P: 110 VDC O/P: F ULL LOAD Ta:25°C	110VDC/ 15.8ms
---	--------------------	---------------	--	----------------


INPUT=110VDC @ FULL LOAD

CH1 : DC Input Voltage CH2 : Output Voltage

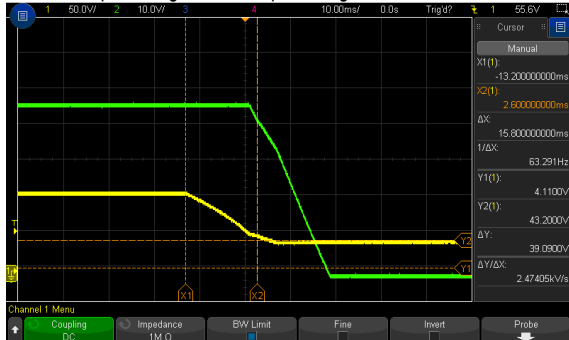


9	DYNAMIC LOAD	V1: 4800 mVp-p	I/P: 110VDC O/P: (1)FULL /MIN LOAD 50%DUTY / 120HZ (2)FULL /MIN LOAD 50%DUTY / 1KHZ Ta:25°C	2170mVp-p 1750mVp-p
---	--------------	----------------	---	------------------------

FULL /MIN LOAD 50%DUTY / 120HZ

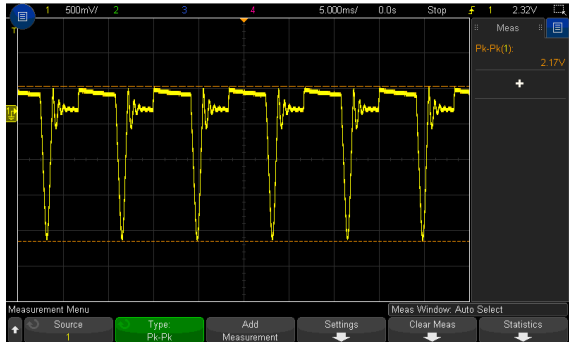

FULL /MIN LOAD 50%DUTY / 1KHZ

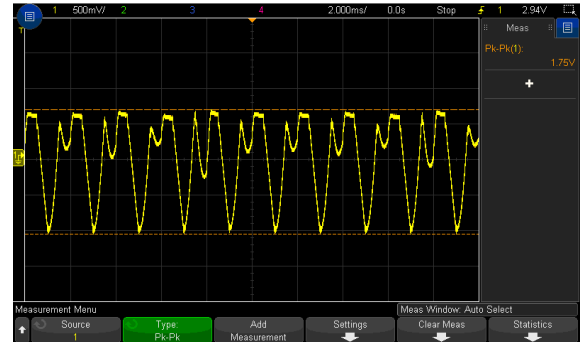

### INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	67.2 VDC~ 154 VDC	I/P: TESTING O/P: FULL LOAD Ta:25°C	59.9V~ 154 V
			I/P: LOW-LINE-0.2= 67 V HIGH-LINE+3V= 157 V O/P: FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec . OFF: 30 Sec 10MIN ( POWER ON/OFF NO DAMAGE )	TEST:(1) <u>  OK  </u> (2) <u>  OK  </u> (3) <u>  OK  </u>

2	INPUT CURRENT(TYP)	110VDC/ 1.3 A	I/P: 110VDC O/P:FULL LOAD Ta:25°C	I=1.17A/110VDC																						
3	EFFICIENCY(TYP)	91.5 %	I/P: 110VDC O/P:FULL LOAD Ta:25°C	92.25%																						
<p>EFFICIENCY vs LOAD</p> <table border="1"> <caption>Efficiency vs Load Data (48VDC)</caption> <thead> <tr> <th>LOAD (%)</th> <th>EFFICIENCY (%)</th> </tr> </thead> <tbody> <tr><td>10%</td><td>83</td></tr> <tr><td>20%</td><td>88</td></tr> <tr><td>30%</td><td>90</td></tr> <tr><td>40%</td><td>91</td></tr> <tr><td>50%</td><td>92</td></tr> <tr><td>60%</td><td>92</td></tr> <tr><td>70%</td><td>93</td></tr> <tr><td>80%</td><td>93</td></tr> <tr><td>90%</td><td>93</td></tr> <tr><td>100%</td><td>93</td></tr> </tbody> </table>					LOAD (%)	EFFICIENCY (%)	10%	83	20%	88	30%	90	40%	91	50%	92	60%	92	70%	93	80%	93	90%	93	100%	93
LOAD (%)	EFFICIENCY (%)																									
10%	83																									
20%	88																									
30%	90																									
40%	91																									
50%	92																									
60%	92																									
70%	93																									
80%	93																									
90%	93																									
100%	93																									
4	INRUSH CURRENT(TYP)	110VDC/ 20 A COLD START	I/P: 110VDC O/P:FULL LOAD Ta:25°C	I=4.02A/110 VDC																						
<p>INPUT=110VDC @ FULL LOAD</p>																										

### PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	105%~135%RATED OUTPUT POWER	I/P: 67.2 VDC I/P: 110 VDC I/P: 154 VDC O/P:TESTING Ta:25°C	120.4%/ 154VDC 120%/110VDC 119.6%/ 67.2VDC PROTECTION TYPE : Normally works within 105~150% rated output power for more than 3 seconds and then constant current protection with auto-recovery >150% rated power ,constant current limiting with auto-recovery
2	OVER VOLTAGE PROTECTION	CH: 57.6 V~ 67.2 V	I/P: 154 VDC I/P: 110 VDC I/P: 67.2 VDC O/P:MIN LOAD Ta:25°C	61.1V/154VDC 61.1V/ 110 VDC 61.1V/ 67.2 VDC PROTECTION TYPE : Shut down O/P voltage,re-power on to recover
3	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 154 VDC O/P: FULL LOAD Ta:25°C	NO DAMAGE PROTECTION TYPE : Normally works within 105~150% rated output power for more than 3 seconds and then constant current protection with auto-recovery >150% rated power ,constant



				current limiting with auto-recovery
4	INPUT REVERSE	POWER OK	I/P:154 VDC O/P: NO LOAD Ta:25°C	NO DAMAGE

### COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor ( D to S) or (C to E) Peak Voltage	Q5 Rated : /400 V  Q6 Rated : -400 V	I/P:High-Line +3V =157V DC ON/OFF VDS: O/P: (1)Full Load (2)Output Short (3) Full Load Continue Ta:25°C	Q5 VDS: (1) 236V (2) 180V (3) 218V  Q6 VDS: (1) 234V (2) 178V (3) 222V
2	Diode Peak Voltage	Q101 Rated : 400V  Q100 Rated : 400V	I/P:High-Line +3V =157 V DC ON/OFF O/P: (1)Full Load (2)Output Short (3) Full Load Continue Ta:25°C	Q100: VDS: (1) 213V (2) 109V (3) 77V  Q101: VDS: (1) 346V (2) 366V (3) 338V
3	Input Capacitor Voltage	C5 Rated: : 120 μ / 160 V	I/P:High-Line +3V =157 V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change (4)Full load continue Ta:25°C	C5: (1)163V (2) 161V (3) 159V (4) 159V
4	Control IC Voltage Test	PWM IC U1 Rated -0.3V~16V	I/P:High-Line +3V =157 V DC ON/OFF O/P:(1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. Ta:25°C	U1: (1) 14.1 V (2) 13.9V (3) 14.3 V (4) 14.1V

### SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P:4KVDC/min I/P-FG:2.5KVDC/min O/P-FG:2.5KVDC/min	I/P-O/P: 4.4KVDC/min I/P-FG: 3 KVDC/min O/P-FG:3KVDC/min Ta:25°C	I/P-O/P: 0 mA I/P-FG: 0 mA O/P-FG: 0 mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P: 9999MΩ I/P-FG: 9999 MΩ O/P-FG:9999 MΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	10mΩ

### E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	RADIATION	<input checked="" type="checkbox"/> EN55032 <input type="checkbox"/> EN55011 <input type="checkbox"/> CLASS A <input checked="" type="checkbox"/> CLASS B	I/P: 110 VDC O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> PASS <input type="checkbox"/> FAIL Test by certified Lab



2	CONDUCTION	<input checked="" type="checkbox"/> EN55032 <input type="checkbox"/> EN55011 <input type="checkbox"/> CLASS A <input checked="" type="checkbox"/> CLASS B	I/P: 110 VDC O/P: FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> PASS <input type="checkbox"/> FAIL Test by certified Lab
3	E.S.D	EN61000-4-2 <input type="checkbox"/> Din rail Model : AIR: 8KV / Contact: 6KV	I/P: 110VDC O/P: FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
4	E.F.T	EN61000-4-4 <input type="checkbox"/> INDUSTRY INPUT: 2KV	I/P: 110VDC O/P: FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
5	SURGE	IEC61000-4-5 <input type="checkbox"/> INDUSTRY L-N :1KV L,N-FG:2KV	I/P: 110VDC O/P: FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> CRITERIA A <input type="checkbox"/> CRITERIA B
6	Test by certified Lab & Test Report Prepare			

## RELIABILITY TEST

### ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																												
2	TEMPERATURE RISE TEST	MODEL : DDR-120D-48 1. ROOM AMBIENT BURN-IN : 1 HRS I/P : 110 VDC O/P : FULL LOAD Ta= 23.1 °C 2. HIGH AMBIENT BURN-IN : 1 HRS I/P : 110 VDC O/P : FULL LOAD Ta= 50.8 °C																																																																																														
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 23.1 °C</th> <th>HIGH AMBIENT Ta= 50.8 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF1</td><td>47.2°C</td><td>77.6°C</td></tr> <tr><td>2</td><td>LF2</td><td>41.6°C</td><td>72.6°C</td></tr> <tr><td>3</td><td>LF100</td><td>45.9°C</td><td>75.2°C</td></tr> <tr><td>4</td><td>T1</td><td>62.3°C</td><td>91.8°C</td></tr> <tr><td>5</td><td>T2</td><td>48.6°C</td><td>78.2°C</td></tr> <tr><td>6</td><td>Q1</td><td>45.9°C</td><td>76.5°C</td></tr> <tr><td>7</td><td>Q2</td><td>46.6°C</td><td>76.9°C</td></tr> <tr><td>8</td><td>Q5</td><td>51.7°C</td><td>82.1°C</td></tr> <tr><td>9</td><td>Q6</td><td>45.7°C</td><td>76.4°C</td></tr> <tr><td>10</td><td>Q100</td><td>55.5°C</td><td>84.7°C</td></tr> <tr><td>11</td><td>Q101</td><td>58.6°C</td><td>87.7°C</td></tr> <tr><td>12</td><td>L100</td><td>71.6°C</td><td>101.6°C</td></tr> <tr><td>13</td><td>C1</td><td>48.3°C</td><td>78.6°C</td></tr> <tr><td>14</td><td>C5</td><td>44.6°C</td><td>75.4°C</td></tr> <tr><td>15</td><td>C6</td><td>42.9°C</td><td>72.6°C</td></tr> <tr><td>16</td><td>C7</td><td>45.3°C</td><td>75.4°C</td></tr> <tr><td>17</td><td>C8</td><td>53.8°C</td><td>83.5°C</td></tr> <tr><td>18</td><td>C101</td><td>50.4°C</td><td>79.7°C</td></tr> <tr><td>19</td><td>C102</td><td>43.3°C</td><td>71.9°C</td></tr> <tr><td>20</td><td>C104</td><td>50.1°C</td><td>79.5°C</td></tr> <tr><td>21</td><td>C106</td><td>55.4°C</td><td>85.5°C</td></tr> <tr><td>22</td><td>ZNR1</td><td>41.3°C</td><td>71.5°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 23.1 °C	HIGH AMBIENT Ta= 50.8 °C	1	LF1	47.2°C	77.6°C	2	LF2	41.6°C	72.6°C	3	LF100	45.9°C	75.2°C	4	T1	62.3°C	91.8°C	5	T2	48.6°C	78.2°C	6	Q1	45.9°C	76.5°C	7	Q2	46.6°C	76.9°C	8	Q5	51.7°C	82.1°C	9	Q6	45.7°C	76.4°C	10	Q100	55.5°C	84.7°C	11	Q101	58.6°C	87.7°C	12	L100	71.6°C	101.6°C	13	C1	48.3°C	78.6°C	14	C5	44.6°C	75.4°C	15	C6	42.9°C	72.6°C	16	C7	45.3°C	75.4°C	17	C8	53.8°C	83.5°C	18	C101	50.4°C	79.7°C	19	C102	43.3°C	71.9°C	20	C104	50.1°C	79.5°C	21	C106	55.4°C	85.5°C	22	ZNR1	41.3°C	71.5°C
NO	Position	ROOM AMBIENT Ta= 23.1 °C	HIGH AMBIENT Ta= 50.8 °C																																																																																													
1	LF1	47.2°C	77.6°C																																																																																													
2	LF2	41.6°C	72.6°C																																																																																													
3	LF100	45.9°C	75.2°C																																																																																													
4	T1	62.3°C	91.8°C																																																																																													
5	T2	48.6°C	78.2°C																																																																																													
6	Q1	45.9°C	76.5°C																																																																																													
7	Q2	46.6°C	76.9°C																																																																																													
8	Q5	51.7°C	82.1°C																																																																																													
9	Q6	45.7°C	76.4°C																																																																																													
10	Q100	55.5°C	84.7°C																																																																																													
11	Q101	58.6°C	87.7°C																																																																																													
12	L100	71.6°C	101.6°C																																																																																													
13	C1	48.3°C	78.6°C																																																																																													
14	C5	44.6°C	75.4°C																																																																																													
15	C6	42.9°C	72.6°C																																																																																													
16	C7	45.3°C	75.4°C																																																																																													
17	C8	53.8°C	83.5°C																																																																																													
18	C101	50.4°C	79.7°C																																																																																													
19	C102	43.3°C	71.9°C																																																																																													
20	C104	50.1°C	79.5°C																																																																																													
21	C106	55.4°C	85.5°C																																																																																													
22	ZNR1	41.3°C	71.5°C																																																																																													
3	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR ( MIN )	I/P : 110 VDC O/P : 120 % LOAD Ta : 25°C	TEST : OK																																																																																												



# 120W DC-DC DIN Rail Power Supply

# DDR-120D series

4	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 86.4 VDC/ 154 VDC O/P : 100 % LOAD Ta= -45 °C	TEST : OK												
5	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 55 °C NO DAMAGE	I/P : 157 VDC O/P : FULL LOAD Ta= 55 °C HUMIDITY= 95 %R.H	TEST : OK												
6	TEMPERATURE COEFFICIENT	± 0.03 %(0~55°C)	I/P : 110 VDC O/P : FULL LOAD	± 0.009 %(0~55°C)												
7	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : STATIC		TEST : OK												
8.	THERMAL SHOCK TEST	1. Thermal shock Temperature : -45°C~ +60°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/Output condition : 110VDC/Full Load DC ON/OFF TEST turn on 3sec : turn off 1sec@15cycle\ 110VDC/Full Load DC ON@1cycle		TEST : OK												
9	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 5G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C  2 Din Rail <table border="1" style="margin-left: 20px;"> <thead> <tr> <th></th> <th>Displacement</th> <th>Acceleration</th> </tr> </thead> <tbody> <tr> <td>2 (+3/-0) Hz up to 15Hz</td> <td>± 2.5mm</td> <td>-----</td> </tr> <tr> <td>15Hz up to 50Hz</td> <td>-----</td> <td>2.3g</td> </tr> <tr> <td>Sweep rate</td> <td colspan="2">Max 1 Octave/minute</td> </tr> </tbody> </table>			Displacement	Acceleration	2 (+3/-0) Hz up to 15Hz	± 2.5mm	-----	15Hz up to 50Hz	-----	2.3g	Sweep rate	Max 1 Octave/minute		TEST : OK
	Displacement	Acceleration														
2 (+3/-0) Hz up to 15Hz	± 2.5mm	-----														
15Hz up to 50Hz	-----	2.3g														
Sweep rate	Max 1 Octave/minute															
10	CAPACITOR LIFE CYCLE	SUPPOSE C102 IS THE MOST CRITICAL COMPONENT (1) I/P : 110VDC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 110VDC O/P : FULL LOAD Ta= 55 °C LIFE TIME (3) I/P : 110VDC O/P : 75% LOAD Ta= 55 °C LIFE TIME (4) I/P : 110VDC O/P : 50% LOAD Ta= 55 °C LIFE TIME		(1) 598693.2 HRS (2) 70283.9 HRS (3) 98741.2 HRS (4) 127646.1 HRS												
11	MTBF	Conducted by Parts Stress Analysis Prediction 1769.5K hrs min. Telcordia SR-332 (Bellcore) ; 214.5K hrs min. MIL-HDBK-217F (25°C)														
12	DMTBF/Accelerated Life Test	Demonstration Mean Time Between Failure (Expected Life): Above 30,000 hours @ TA 55°C														

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	LIUTT		WANGDZ

12.10.30 A50-F031