



Test Report: ELG-150-12

150W Single Output Switching Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test

■ RELIABILITY TEST


Environment Test

■ DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	CONSTANT CURRENT REGION	6V~12V	I/P: 230VAC O/P: LED MODE Ta: 25°C	5.44 V~ 12.07 V
2	OUTPUT VOLTAGE ADJUST RANGE	10.8V~13.2V	I/P: 230VAC O/P: NO LOAD Ta: 25°C	9.93 V~ 13.75 V
3	OUTPUT CURRENT ADJUST RANGE	5A~10A	I/P: 230VAC O/P: SETTING Ta: 25°C	4.255 A~ 11.548 A
4	OUTPUT VOLTAGE TOLERANCE	-3%~+3%	I/P: 100VAC / 305VAC O/P: FULL/ NO LOAD Ta: 25°C	-0.66%~ 1.66%
5	LINE REGULATION	-0.5%~+0.5%	I/P: 200VAC ~ 305VAC O/P: FULL LOAD Ta: 25°C	0%~ 0%
6	LOAD REGULATION	-2%~+2%	I/P: 230VAC O/P: FULL ~NO LOAD Ta: 25°C	-0.41%~ 0.41%
7	OVER/UNDERSHOOT TEST	<± 5 %	I/P: 230VAC O/P: FULL LOAD Ta: 25°C	±2.564%
8	RIPPLE & NOISE (Max)	150mVp-p	I/P: 230VAC O/P: FULL LOAD Ta: 25°C	23.6 mVp-p

high frequency :

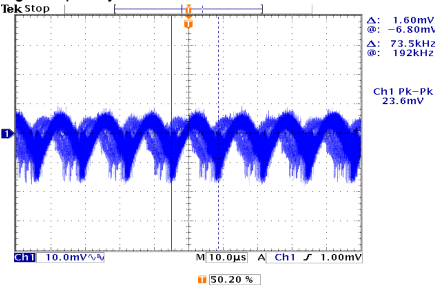


low frequency :




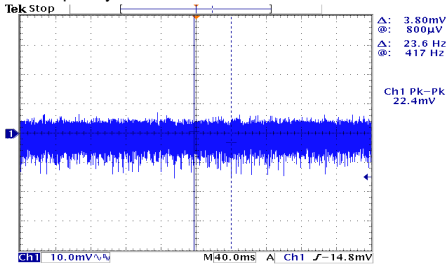


9	SET UP TIME(Max)	230VAC/ 500ms	I/P: 230 VAC O/P: 95% LOAD Ta: 25°C	230VAC/ 230 ms
---	------------------	---------------	---	----------------

INPUT=230VAC/50HZ @ 95% LOAD

CH1: Output Voltage CH2: AC Input Voltage

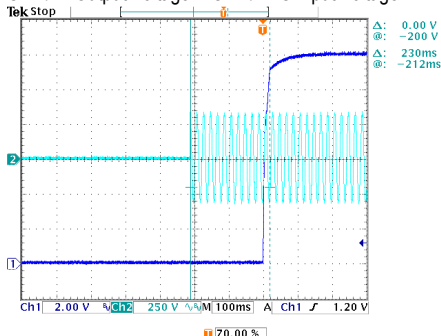

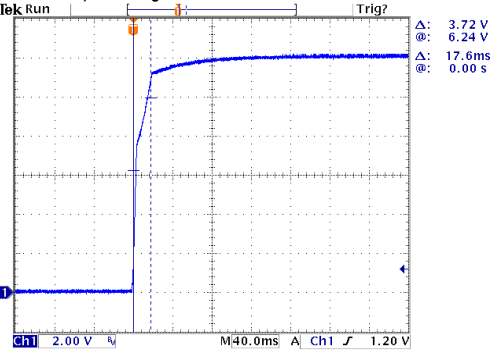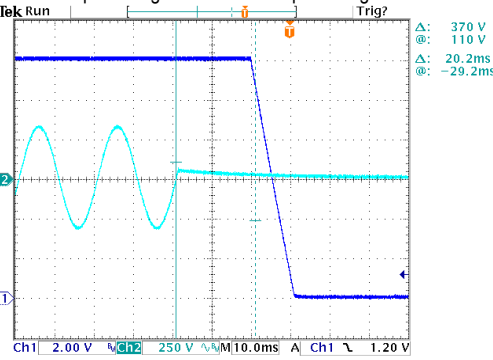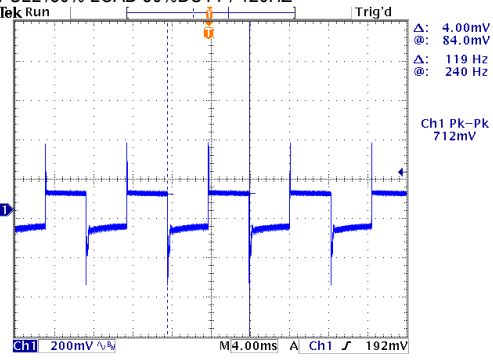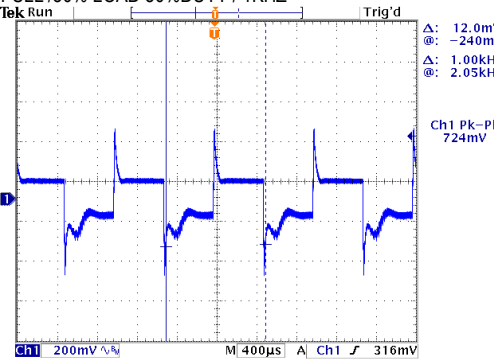10	RISE TIME (Max)	230VAC/ 100ms	I/P: 230 VAC O/P: 95% LOAD Ta: 25°C	230VAC/ 17.6 ms
<p>INPUT=230VAC/50HZ @ 95% LOAD</p> <p>CH1: Output Voltage</p>  <p>Δ: 3.72 V @: 6.24 V Δ: 17.6ms @: 0.00 s</p> <p>30.00 %</p>				
11	HOLD UP TIME(Typ)	230VAC/ 10ms	I/P: 230 VAC O/P: 95% LOAD Ta: 25°C	230VAC/ 20.2 ms
<p>INPUT=230VAC/50HZ @ 95% LOAD</p> <p>CH1: Output Voltage CH2: AC Input Voltage</p>  <p>Δ: 370 V @: 110 V Δ: 20.2ms @: -29.2ms</p> <p>70.00 %</p>				
12	DYNAMIC LOAD	V1: 1200 mVp-p	I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta: 25°C	(1) 712mVp-p (2) 724mVp-p
<p>FULL /50% LOAD 50%DUTY / 120HZ</p>  <p>Δ: 4.00mV @: 84.0mV Δ: 119 Hz @: 240 Hz</p> <p>Ch1 Pk-Pk 712mV</p> <p>49.40 %</p> <p>FULL /50% LOAD 50%DUTY / 1KHZ</p>  <p>Δ: 12.0mV @: -240mV Δ: 1.00kHz @: 2.05kHz</p> <p>Ch1 Pk-Pk 724mV</p> <p>49.40 %</p>				


13	DIMMING TEST (For B-Type only)	SPEC:													
		※ Built-in 3 in 1 dimming function, IP67 rated. Output constant current level can be adjusted through output cable by connecting a resistance or 0 ~ 10Vdc or 10V PWM signal between DIM+ and DIM-.													
		※ Please DO NOT connect "DIM-" to "-V".													
		※ Reference resistance value for output current adjustment (Typical)													
		Resistance value	Single driver	Short	10K Ω	20K Ω	30K Ω	40K Ω	50K Ω	60K Ω	70K Ω	80K Ω	90K Ω	100K Ω	OPEN
			Multiple drivers (N=driver quantity for synchronized dimming operation)	Short	10K Ω/N	20K Ω/N	30K Ω/N	40K Ω/N	50K Ω/N	60K Ω/N	70K Ω/N	80K Ω/N	90K Ω/N	100K Ω/N
		Percentage of rated current		0%	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%	95%~108%
		※ 0 ~ 10V dimming function for output current adjustment (Typical)													
		Dimming value		0V	1V	2V	3V	4V	5V	6V	7V	8V	9V	10V	OPEN
		Percentage of rated current		0%	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%	95%~108%
		※ 10V PWM signal for output current adjustment (Typical): Frequency range: 100Hz~3KHz													
		Duty value		0%	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%	OPEN
		Percentage of rated current		0%	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%	95%~108%
TEST RESULT:															
I/P: 230 VAC; Ta: 25°C															
1	Resistance value	Short	10K	20K	30K	40K	50K	60K	70K	80K	90K	100K	OPEN		
	Output Current	0	0.876	1.917	2.965	4.031	5.101	6.179	7.266	8.376	9.471	10.173	10.182		
	Percentage of rated current	0%	8.76%	19.17%	29.65%	40.31%	51.01%	61.79%	72.66%	83.76%	94.71%	101.73%	101.82%		
2	Dimming value	0V	1V	2V	3V	4V	5V	6V	7V	8V	9V	10V	OPEN		
	Output Current	0	0.898	1.923	2.905	3.957	4.989	6.071	7.135	8.149	9.209	10.179	10.201		
	Percentage of rated current	0%	8.98%	19.23%	29.05%	39.57%	49.89%	60.71%	71.35%	81.49%	92.09%	101.79%	102.01%		
3	Duty value	0%	10%	20%	30%	40%	50%	60%	70%	80%	90%	100%	OPEN		
	Output Current	0	0.962	1.955	2.972	3.992	5.030	6.064	7.101	8.152	9.192	10.139	10.217		
	Percentage of rated current	0%	9.62%	19.55%	29.72%	39.92%	50.30%	60.64%	71.01%	81.52%	91.92%	101.39%	102.17%		

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	100VAC~305VAC	I/P: TESTING O/P: FULL LOAD Ta: 25°C	97 V~ 305 V
			I/P: LOW-LINE-3V=97 V HIGH-LINE+10V=315 V O/P: FULL/NO LOAD ON: 30 Sec OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	TEST: OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P: 100 VAC ~305 VAC O/P: FULL~NO LOAD Ta: 25°C	TEST: OK
3	AC CURRENT	0.7A/277VAC 0.9A/230VAC	I/P: 277 VAC I/P: 230 VAC O/P: FULL LOAD Ta: 25°C	I = 0.47 A/ 277VAC I = 0.56 A/ 230VAC
4	LEAKAGE CURRENT	< 0.75mA / 277VAC	I/P: 277 VAC O/P: NO LOAD Ta: 25°C	L-FG: 0.385 mA N-FG: 0.345 mA
5	NO LOAD POWER CONSUMPTION	< 0.5W	I/P: 230VAC O/P: NO LOAD Ta: 25°C	0.147 W/ 230VAC
6	TOTAL HARMONIC DISTORTION	Total harmonic distortion will be lower than 20% when output loading is 50% or higher at 230VAC	I/P: 230VAC O/P: 50% LOAD	THD: 10.47 %
		Total harmonic distortion will be lower than 20% when output loading is 75% or higher at 277VAC	I/P: 277VAC O/P: 75% LOAD	THD: 9.25 %
7	INRUSH CURRENT(Typ)	230V/ 65A Twidth =550us measured at 50% Ipeak COLD START	I/P: 230 VAC O/P: FULL LOAD Ta: 25°C	I = 52.2 A/ 230VAC Twidth =424 us

INPUT=230VAC/50HZ @ FULL LOAD

CH2: Input current CH1: AC Input Voltage

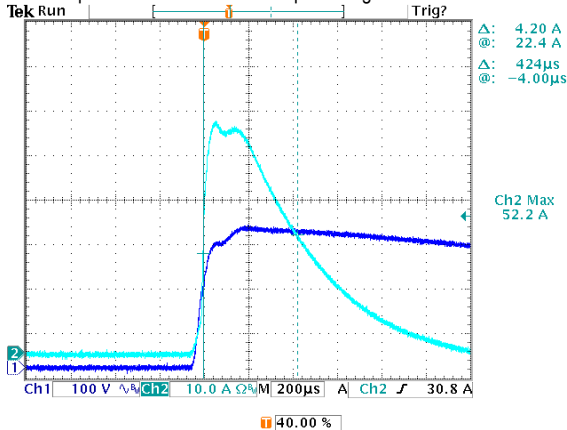

8	EFFICIENCY(Typ)	88%	I/P: 230VAC O/P: FULL LOAD Ta: 25°C	89.44 %																																	
<p>EFFICIENCY vs LOAD</p> <table border="1"> <caption>Efficiency vs Load Data</caption> <thead> <tr> <th>LOAD (%)</th> <th>277V Efficiency (%)</th> <th>230V Efficiency (%)</th> </tr> </thead> <tbody> <tr><td>10%</td><td>74%</td><td>68%</td></tr> <tr><td>20%</td><td>80%</td><td>81%</td></tr> <tr><td>30%</td><td>85%</td><td>86%</td></tr> <tr><td>40%</td><td>87%</td><td>88%</td></tr> <tr><td>50%</td><td>88%</td><td>89%</td></tr> <tr><td>60%</td><td>89%</td><td>89.44%</td></tr> <tr><td>70%</td><td>89.44%</td><td>89.44%</td></tr> <tr><td>80%</td><td>89.44%</td><td>89.44%</td></tr> <tr><td>90%</td><td>89.44%</td><td>89.44%</td></tr> <tr><td>100%</td><td>89.44%</td><td>89.44%</td></tr> </tbody> </table>					LOAD (%)	277V Efficiency (%)	230V Efficiency (%)	10%	74%	68%	20%	80%	81%	30%	85%	86%	40%	87%	88%	50%	88%	89%	60%	89%	89.44%	70%	89.44%	89.44%	80%	89.44%	89.44%	90%	89.44%	89.44%	100%	89.44%	89.44%
LOAD (%)	277V Efficiency (%)	230V Efficiency (%)																																			
10%	74%	68%																																			
20%	80%	81%																																			
30%	85%	86%																																			
40%	87%	88%																																			
50%	88%	89%																																			
60%	89%	89.44%																																			
70%	89.44%	89.44%																																			
80%	89.44%	89.44%																																			
90%	89.44%	89.44%																																			
100%	89.44%	89.44%																																			
9	POWER FACTOR	0.92/ 277VAC 0.95/ 230VAC	I/P: 277 VAC I/P: 230 VAC O/P: FULL LOAD Ta: 25°C	PF= 0.973 / 277VAC PF= 0.989 / 230VAC																																	
<p>P.F vs LOAD</p> <p>Constant Current Mode</p> <table border="1"> <caption>P.F vs Load Data</caption> <thead> <tr> <th>LOAD (%)</th> <th>277V PF</th> <th>230V PF</th> </tr> </thead> <tbody> <tr><td>50%</td><td>0.92</td><td>0.97</td></tr> <tr><td>60%</td><td>0.94</td><td>0.977</td></tr> <tr><td>70%</td><td>0.955</td><td>0.982</td></tr> <tr><td>80%</td><td>0.965</td><td>0.987</td></tr> <tr><td>90%</td><td>0.97</td><td>0.989</td></tr> <tr><td>100%</td><td>0.973</td><td>0.989</td></tr> </tbody> </table>					LOAD (%)	277V PF	230V PF	50%	0.92	0.97	60%	0.94	0.977	70%	0.955	0.982	80%	0.965	0.987	90%	0.97	0.989	100%	0.973	0.989												
LOAD (%)	277V PF	230V PF																																			
50%	0.92	0.97																																			
60%	0.94	0.977																																			
70%	0.955	0.982																																			
80%	0.965	0.987																																			
90%	0.97	0.989																																			
100%	0.973	0.989																																			

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	95%~108%	I/P: 200VAC I/P: 230VAC I/P: 305VAC O/P: TESTING Ta: 25°C	103.09 %/ 200VAC 102.81 %/ 230VAC 102.62 %/ 305VAC Constant Current Limiting, recovers automatically after fault condition is removed
2	OVER VOLTAGE PROTECTION	14V~18V	I/P: 100VAC I/P: 230VAC I/P: 305VAC O/P: NO LOAD Ta: 25°C	16.20 V/ 100VAC 16.20 V/ 230VAC 16.20 V/ 305VAC Shut down o/p voltage, re-power on to recovery
3	OVER TEMPERATURE PROTECTION	NO DAMAGE	I/P: 200VAC I/P: 230VAC I/P: 305VAC O/P: FULL LOAD	O.T.P. Active Shut down o/p voltage, re-power on to recovery
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 200VAC I/P: 305VAC O/P: FULL LOAD Ta: 25°C	NO DAMAGE Hiccup mode, recovers automatically after fault condition is removed

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Power Transistor	Q 2 Rated 730V/10A	I/P: High-Line +3V =308V O/P: (1) Full Load Turn on (2) Output Short (3) Full load continue Ta: 25°C	(1) 652 V (2) 626 V (3) 644 V
2	O/P Diode (MOSFET)	Q101 Rated 75V/80A	I/P: High-Line +3V =308V O/P: (1) Full Load Turn on (2) Output Short (3) Full load continue Ta: 25°C	(1) 71.6 V (2) 71.6 V (3) 70.2 V
3	Input Capacitor	C5 Rated 100u/ 450V	I/P: High-Line +3V =308 V O/P: (1) Full Load input on/off (2) NO LOAD input on /Off (3) Full Load /NO LOAD Change Ta: 25°C	(1) 444 V (2) 444 V (3) 444 V
4	Control IC	U1 Rated 28V (MAX.)	I/P: High-Line +3V =308 V O/P: ((1) FULL LOAD (2) Output Short (3) O.L.P (4) O.V.P (5) Low Line No Load Vo(min) Ta: 25°C	(1) 17.3 V (2) 15.1 V (3) 15.7 V (4) 15.1 V (5) 17.0 V
5	PFC Power Transistor	Q 1 Rated 600V/10A	I/P: High-Line +3V =308V O/P: (1) Full Load Turn on (2) Output Short (3) Full load continue Ta: 25°C	(1) 542 V (2) 496 V (3) 496 V



6	Clamp Diode	D 10 Rated 800V/2A	I/P: High-Line +3V = 308V O/P: (1) Full Load input on/off (2) Output Short Ta: 25°C	(1) 570 V (2) 480 V
---	-------------	-----------------------	--	------------------------

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 3.75KVAC/min I/P-FG: 2.0KVAC/min O/P-FG: 1.5KVAC/min	I/P-O/P: 4.2KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG: 1.8 KVAC/min Ta: 25°C	I/P-O/P: 1.535 mA I/P-FG: 2.275 mA O/P-FG: 1.561 mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P: 500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG: 500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta: 25°C	I/P-O/P: >9999 MΩ I/P-FG: >9999 MΩ O/P-FG: >9999 MΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS C	I/P: 230VAC/50HZ O/P: FULL/50% LOAD Ta: 25°C	PASS
2	CONDUCTION	EN55015	I/P: 230 VAC (50HZ) O/P: FULL LOAD Ta: 25°C	PASS Test by certified Lab
3	RADIATION	EN55015	I/P: 230 VAC (50HZ) O/P: FULL LOAD Ta: 25°C	PASS Test by certified Lab
4	E.S.D	EN61000-4-2 LIGHT INDUSTRY AIR: 8KV Contact: 4KV	I/P: 230 VAC/50HZ O/P: FULL LOAD Ta: 25°C	CRITERIA A
5	E.F.T	EN61000-4-4 LIGHT INDUSTRY INPUT: 1KV	I/P: 230VAC/50HZ O/P: FULL LOAD Ta: 25°C	CRITERIA A
6	SURGE	EN61000-4-5 INDUSTRY L-N: 4KV L,N-PE: 6KV	I/P: 230VAC/50HZ O/P: FULL LOAD L-N: 4KV L,N-PE: 6KV Ta: 25°C	CRITERIA A
7	Test by certified Lab & Test Report Prepare			

■ **RELIABILITY TEST**

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																																				
1	TEMPERATURE RISE TEST	MODEL: ELG-150-12 1. ROOM AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=31.7 °C 2. HIGH AMBIENT BURN-IN: 2 HRS I/P: 230VAC O/P: FULL LOAD Ta=63.5 °C																																																																																																						
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta=31.7 °C</th> <th>HIGH AMBIENT Ta=63.5 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>LF2</td><td>61.7°C</td><td>90.0°C</td></tr> <tr><td>2</td><td>L1</td><td>66.9°C</td><td>92.1°C</td></tr> <tr><td>3</td><td>L3</td><td>63.5°C</td><td>90.7°C</td></tr> <tr><td>4</td><td>ZNR2</td><td>66.8°C</td><td>91.8°C</td></tr> <tr><td>5</td><td>C11</td><td>64.7°C</td><td>93.7°C</td></tr> <tr><td>6</td><td>Q1</td><td>70.1°C</td><td>96.4°C</td></tr> <tr><td>7</td><td>Q2</td><td>72.5°C</td><td>103.4°C</td></tr> <tr><td>8</td><td>D6</td><td>70.4°C</td><td>97.4°C</td></tr> <tr><td>9</td><td>D10</td><td>77.0°C</td><td>107.5°C</td></tr> <tr><td>10</td><td>U1</td><td>64.7°C</td><td>91.9°C</td></tr> <tr><td>11</td><td>R7</td><td>81.1°C</td><td>109.5°C</td></tr> <tr><td>12</td><td>C5</td><td>66.8°C</td><td>94.8°C</td></tr> <tr><td>13</td><td>T1</td><td>72.8°C</td><td>99.1°C</td></tr> <tr><td>14</td><td>C45</td><td>64.3°C</td><td>93.8°C</td></tr> <tr><td>15</td><td>U100</td><td>61.6°C</td><td>87.4°C</td></tr> <tr><td>16</td><td>U101</td><td>62.0°C</td><td>92.7°C</td></tr> <tr><td>17</td><td>Q101</td><td>68.1°C</td><td>96.2°C</td></tr> <tr><td>18</td><td>Q102</td><td>64.5°C</td><td>95.9°C</td></tr> <tr><td>19</td><td>C205</td><td>65.0°C</td><td>93.4°C</td></tr> <tr><td>20</td><td>C105</td><td>60.7°C</td><td>89.2°C</td></tr> <tr><td>21</td><td>C106</td><td>64.9°C</td><td>94.0°C</td></tr> <tr><td>22</td><td>C108</td><td>64.7°C</td><td>91.2°C</td></tr> <tr><td>23</td><td>RTH2</td><td>61.7°C</td><td>90.0°C</td></tr> <tr><td>24</td><td>TC</td><td>59.4°C</td><td>84.6°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta=31.7 °C	HIGH AMBIENT Ta=63.5 °C	1	LF2	61.7°C	90.0°C	2	L1	66.9°C	92.1°C	3	L3	63.5°C	90.7°C	4	ZNR2	66.8°C	91.8°C	5	C11	64.7°C	93.7°C	6	Q1	70.1°C	96.4°C	7	Q2	72.5°C	103.4°C	8	D6	70.4°C	97.4°C	9	D10	77.0°C	107.5°C	10	U1	64.7°C	91.9°C	11	R7	81.1°C	109.5°C	12	C5	66.8°C	94.8°C	13	T1	72.8°C	99.1°C	14	C45	64.3°C	93.8°C	15	U100	61.6°C	87.4°C	16	U101	62.0°C	92.7°C	17	Q101	68.1°C	96.2°C	18	Q102	64.5°C	95.9°C	19	C205	65.0°C	93.4°C	20	C105	60.7°C	89.2°C	21	C106	64.9°C	94.0°C	22	C108	64.7°C	91.2°C	23	RTH2	61.7°C	90.0°C	24	TC	59.4°C	84.6°C
NO	Position	ROOM AMBIENT Ta=31.7 °C	HIGH AMBIENT Ta=63.5 °C																																																																																																					
1	LF2	61.7°C	90.0°C																																																																																																					
2	L1	66.9°C	92.1°C																																																																																																					
3	L3	63.5°C	90.7°C																																																																																																					
4	ZNR2	66.8°C	91.8°C																																																																																																					
5	C11	64.7°C	93.7°C																																																																																																					
6	Q1	70.1°C	96.4°C																																																																																																					
7	Q2	72.5°C	103.4°C																																																																																																					
8	D6	70.4°C	97.4°C																																																																																																					
9	D10	77.0°C	107.5°C																																																																																																					
10	U1	64.7°C	91.9°C																																																																																																					
11	R7	81.1°C	109.5°C																																																																																																					
12	C5	66.8°C	94.8°C																																																																																																					
13	T1	72.8°C	99.1°C																																																																																																					
14	C45	64.3°C	93.8°C																																																																																																					
15	U100	61.6°C	87.4°C																																																																																																					
16	U101	62.0°C	92.7°C																																																																																																					
17	Q101	68.1°C	96.2°C																																																																																																					
18	Q102	64.5°C	95.9°C																																																																																																					
19	C205	65.0°C	93.4°C																																																																																																					
20	C105	60.7°C	89.2°C																																																																																																					
21	C106	64.9°C	94.0°C																																																																																																					
22	C108	64.7°C	91.2°C																																																																																																					
23	RTH2	61.7°C	90.0°C																																																																																																					
24	TC	59.4°C	84.6°C																																																																																																					
2	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P: 305VAC/200VAC O/P: FULL LOAD Ta= -45°C	TEST: OK																																																																																																				
3	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 60°C NO DAMAGE	I/P: 305VAC O/P: FULL LOAD Ta=60°C HUMIDITY= 95 %R.H	TEST: OK																																																																																																				
4	TEMPERATURE COEFFICIENT	±0.03 %/°C (0~50°C)	I/P: 230 VAC O/P: FULL LOAD	±0.027 %/°C (0~50°C)																																																																																																				
5	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature: -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle: 5 CYCLE 5. Input/Output condition: STATIC		TEST: OK																																																																																																				



6	THERMAL SHOCK TEST	1. Thermal shock Temperature: -45°C~+65°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle: 10 CYCLE 5. Input/Output condition: 230VAC/Full Load AC ON/OFF TEST AC on 3 sec/AC off 1 sec TEST	TEST: OK
7	VIBRATION TEST	1 Carton & 1 Set (1) Waveform: Sine Wave (2) Frequency: 10~500Hz (3) Sweep Time: 12min/sweep cycle (4) Acceleration: 5G (5) Test Time: 72min in each axis (X.Y.Z) (6) Ta: 25°C	TEST: OK
8	CAPACITOR LIFE CYCLE	ELG-150-12: SUPPOSE C108 IS THE MOST CRITICAL COMPONENT (1) I/P: 230VAC O/P: FULL LOAD Tc= 80 °C LIFE TIME (2) I/P: 230VAC O/P: 75% LOAD Tc= 80 °C LIFE TIME (3) I/P: 230VAC O/P: 50% LOAD Tc= 80 °C LIFE TIME	(1) 38341 HRS (2) 46887 HRS (3) 63801 HRS
9	MTBF	Conducted by Parts Stress Analysis Prediction 2661.6K hrs min. Telcordia SR-332 (Bellcore) ; 313.7K hrs min. MIL-HDBK-217F (25°C)	
10	Ongoing Reliability Test	I/P: 230VAC O/P: FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 50,000 hours	

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	ZHANGZJ/ZHUOKB	SKY	LIUWY