



Test Report: LRS-150F-36

150W Single Output Switching Power Supply

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Component Stress Test

■ SAFETY&E.M.C. TEST

Safety Test

E.M.C. Test

■ RELIABILITY TEST


ENVIRONMENT TEST

DESIGN VERIFY TEST


OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1:32.4V~ 39.6 V	I/P : 230 VAC I/P : 115 VAC O/P : MIN LOAD Ta : 25°C	31.20V~41.08V/230VAC 31.20V~41.08V/115VAC
2	OUTPUT VOLTAGE(Max) TOLERANCE	V1:1%~1 %	I/P: 100VAC /264VAC O/P:FULL/ MIN. LOAD Ta:25°C	V1:0.02%~-0.02%
3	LINE REGULATION(Max)	V1:0.5%~0.5 %	I/P: 100VAC~264VAC O/P:FULL LOAD Ta:25°C	V1:0%~-0.03%
4	LOAD REGULATION(Max)	V1:0.5%~0.5 %	I/P: 230VAC O/P:FULL ~MIN LOAD Ta:25°C	V1:0.02%~0%
5	OVER/UNDERSHOOT TEST	<±5%	I/P: 230VAC O/P:FULL LOAD Ta:25°C	<±5%
6	RIPPLE & NOISE(Max)	V1:200mVp-p	I/P:230VAC O/P:FULL LOAD Ta:25°C	V1:63.6mVp-p

high frequency :

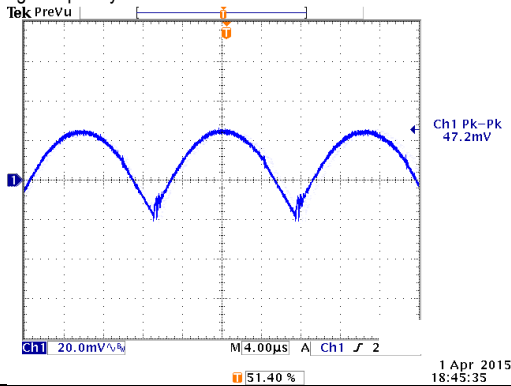


low frequency :

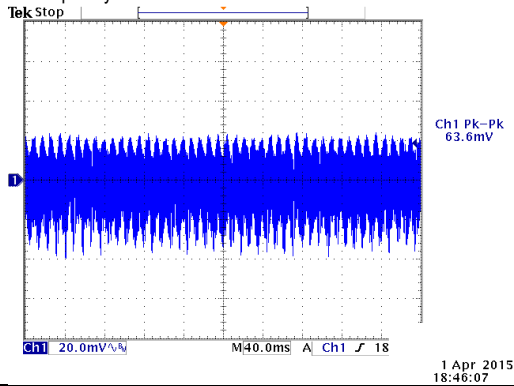

7	SET UP TIME(Max)	230VAC/500ms 115VAC/500ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/226ms 115VAC/160ms
---	------------------	------------------------------	--	------------------------------


INPUT=230VAC/50HZ @ FULL LOAD

CH1 : Output Voltage CH2 : AC Input Voltage

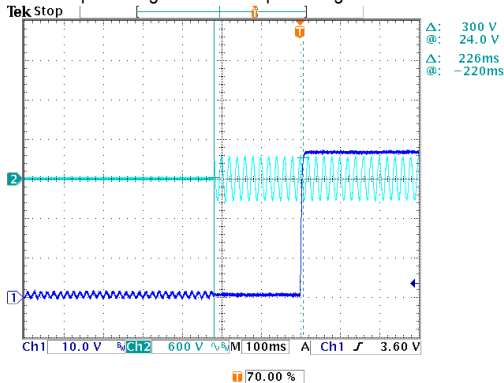

INPUT=115VAC/60HZ @ FULL LOAD

CH1 : Output Voltage CH2 : AC Input Voltage

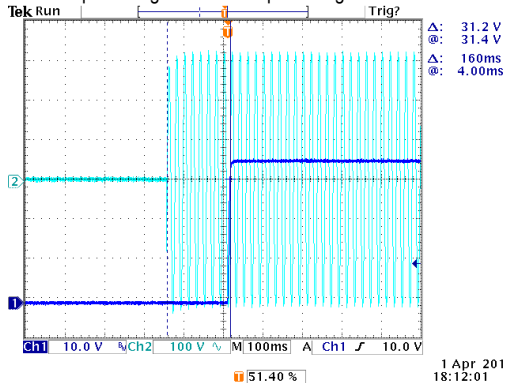

8 RISE TIME (Max)	230VAC/30ms 115VAC/30ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/5.2ms 115VAC/6.4ms
INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage 		INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage 	
9 HOLD UP TIME(Typ.)	230VAC/16ms 115VAC/12ms	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	230VAC/79.6ms 115VAC/16.8ms
INPUT=230VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage 		INPUT=115VAC/60HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage 	
10 DYNAMIC LOAD	V1:3600mVp-p	I/P: 230VAC O/P: (1)FULL /50% LOAD 50%DUTY/120HZ (2)FULL /50% LOAD 50%DUTY/ 1KHZ Ta:25°C	572mVp-p 504mVp-p
FULL /50% LOAD 50%DUTY/120HZ 		FULL /50% LOAD 50%DUTY/ 1KHZ 	





11	TRANSIENT RECOVERY TIME	V1:3600mVp-p	I/P: 230VAC O/P:40% LOAD CHANGE 50%DUTY/120HZ 1.25A/us	392mVp-p
----	-------------------------	--------------	--	----------

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	85VAC~264VAC 120VDC~370VDC	I/P:TESTING O/P:FULL LOAD Ta:25°C	70V~264V 98.9V~370VDC
			I/P: (1)LOW-LINE-3V=82 V HIGH-LINE+15%=300 V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (2)230Vac ON: 0.5 Sec OFF: 0.5 Sec 20MIN (3)230Vac ON:3Sec OFF:3Sec 12HOURS (POWER ON/OFF NO DAMAGE)	TEST:OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P:100 VAC ~264 VAC O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	INPUT CURRENT(Typ.)	230V/ 1.7A 115V/ 3.0A	I/P : 230 VAC I/P : 115 VAC O/P : FULL LOAD Ta : 25°C	I =1.21A/ 230VAC I =2.39A/ 115VAC
4	LEAKAGE CURRENT	<0.75mA / 240 VAC	I/P : 240 VAC O/P : Min LOAD Ta : 25°C	L-FG : 0.225mA N-FG : 0.225mA
5	NO LOAD CONSUMPTION	<0.5W	I/P : 115VAC I/P : 230VAC O/P : NO LOAD Ta : 25°C	<0.1257W <0.0832W
6	EFFICIENCY(Typ.)	89%	I/P:230 VAC O/P:FULL LOAD Ta:25°C	90.03%

EFFICIENCY vs LOAD

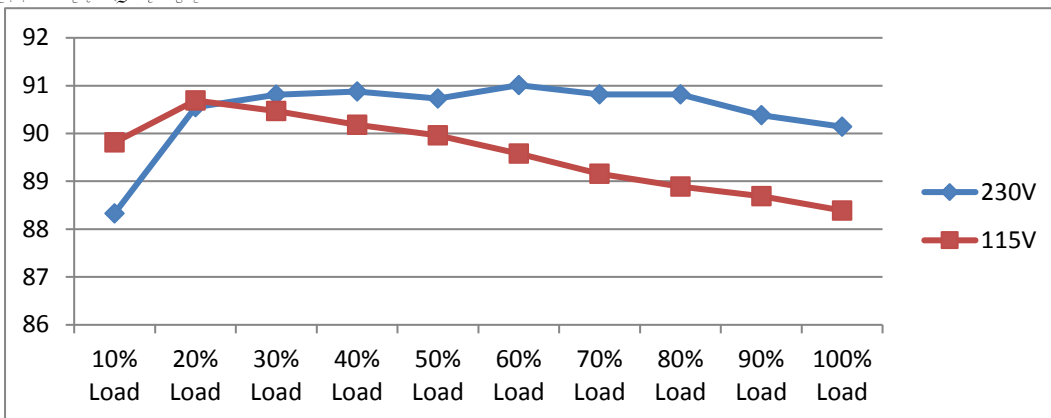

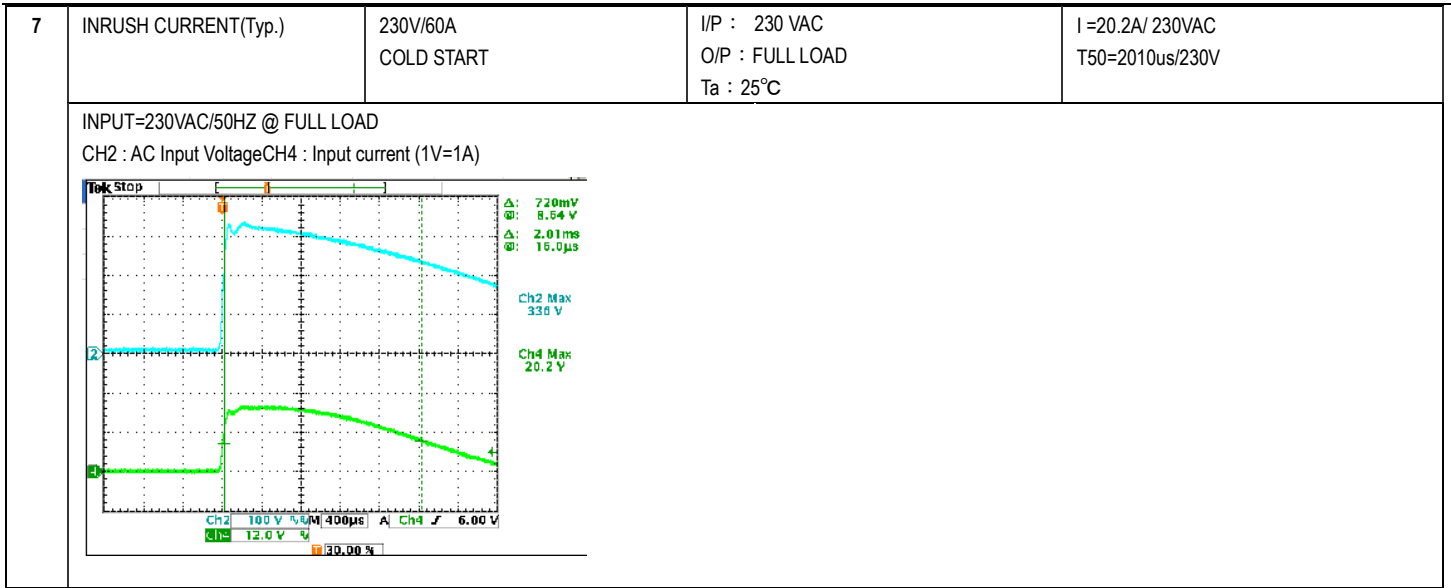

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	110%~ 140 %	I/P: 264VAC I/P: 230VAC I/P: 100VAC O/P: TESTING Ta: 25°C	124%/ 264VAC 122%/ 230VAC 121%/100VAC PROTECTION TYPE : Hiccup mode, recovers automatically after fault condition is removed
2	OVER VOLTAGE PROTECTION	41.4V~48.6V	I/P: 264VAC I/P: 230VAC I/P: 85VAC O/P: MIN LOAD Ta: 25°C	46.03V/264VAC 46.20V/ 230VAC 45.88V/85VAC PROTECTION TYPE : Shut down o/p voltage, re-power on to recover
3	OVER TEMPERATURE PROTECTION	NO DAMAGE	I/P: 264VAC I/P: 85VAC O/P: FULL LOAD	O.T.P. Active PROTECTION TYPE : Shut down o/p voltage, re-power on to recover
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 264VAC I/P: 85VAC O/P: FULL LOAD Ta: 25°C	NO DAMAGE PROTECTION TYPE : Hiccup mode, recovers automatically after fault condition is removed

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor (D to S) or (C to E) Peak Voltage	Q1 Rated :13A/600V	I/P: High-Line +3V =267V AC ON/OFF VDS: O/P: (1) Full Load (2) Output Short (3) Dynamic Load 100% Load/	VDS: (1) 558V (2) 598V (3) 562V

			Min. Load 50%Duty/120Hz (4)0%→400% Load. I/P:Low-Line -3V = 97V O/P: (1)Full Load (2)Output Short (3) Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (4)0%→400% Load. Ta:25°C	(4) 588V VDS: (1) 332V (2)282V (3)328V (4) 340V
2	Diode PeakVoltage	Q101 Rated :20 A/300 V	I/P:High-Line +3V =267 V AC ON/OFF O/P: (1)Full Load (2)Output Short (3) Dynamic Load 100% Load/ Min. Load 50%Duty/120Hz (4)0%→400% Load. (5).NO LOAD Ta:25°C	Q101: VDS: (1) 251V (2) 286V (3) 273V (4)272V (5) 200V
3	Input Capacitor Voltage	C5 Rated: : 120 μ /400V 105°C	I/P:High-Line +3V =267 V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change Ta:25°C	(1)370V (2) 374V (3)374V
4	Control IC Voltage Test	PWM IC U1 Rated : 28V 10.5V(MIN.)	I/P:High-Line +3V =267 V AC ON/OFF O/P:(1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. (5)NO LOAD VR 下限.LOW LINE Ta:25°C	(1)20.5V (2)12.9V (3)19.3V (4)24.6V (5)16.7V

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTANDVOLTAGE	I/P-O/P: 4KVAC/min I/P-FG:2KVAC/min O/P-FG:1.25KVAC/min	I/P-O/P: 4.4 KVAC/min I/P-FG: 2.4 KVAC/min O/P-FG:1.5 KVAC/min Ta:25°C	I/P-O/P:2.67mA I/P-FG:2.02mA O/P-FG:1.86mA NO DAMAGE
2	ISOLATIONRESISTANCE	I/P-O/P:500VDC>100MΩ I/P-FG: 500VDC>100MΩ O/P-FG:500VDC>100MΩ	I/P-O/P: 500 VDC I/P-FG: 500 VDC O/P-FG: 500 VDC Ta:25°C	I/P-O/P:9999MΩ I/P-FG: 9999MΩ O/P-FG:9999MΩ NO DAMAGE
3	GROUNDINGCONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40A / 2min Ta:25°C	28mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P:230VAC/50HZ O/P:80%LOAD Ta:25°C	PASS

	<p>The screenshot shows the 'Harmonic Measurement Panel' software interface. It includes a 'Current Graph' showing a bar chart of current harmonics up to 40th order. Below the graph is a table of measured values:</p> <table border="1"> <tr> <td>V(V)</td> <td>I(A)</td> <td>P(W)</td> <td>PF</td> </tr> <tr> <td>230.60</td> <td>1.1689</td> <td>137.10</td> <td>0.5085</td> </tr> <tr> <td>F(Hz)</td> <td>I Fund(A)</td> <td>THDi(%)</td> <td>V Fund(V)</td> </tr> <tr> <td>50.000</td> <td>0.6076</td> <td>165.35</td> <td>230.63</td> </tr> </table> <p>Additional parameters shown include Regulation (IEC61000-3-2), Class (A), and Class D Parameters (Input Power, Measured, Keyin). The Status section shows 'Measure Start' (ON), 'Current' (PASS), and 'Voltage' (PASS).</p>				V(V)	I(A)	P(W)	PF	230.60	1.1689	137.10	0.5085	F(Hz)	I Fund(A)	THDi(%)	V Fund(V)	50.000	0.6076	165.35	230.63
V(V)	I(A)	P(W)	PF																	
230.60	1.1689	137.10	0.5085																	
F(Hz)	I Fund(A)	THDi(%)	V Fund(V)																	
50.000	0.6076	165.35	230.63																	
2	CONDUCTION	BS EN/EN55032 (CISPR32) CLASS B	I/P : 230 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab																
3	RADIATION	BS EN/EN55032 (CISPR32) CLASS B	I/P : 230 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab																
4	E.S.D	EN61000-4-2 INDUSTRY AIR : 8KV / Contact : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A																
5	E.F.T	EN61000-4-4 INDUSTRY INPUT : 2KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A																
6	SURGE	IEC61000-4-5 INDUSTRY L-N : 2KV L,N-PE : 4KV	I/P : 230 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A																
7	Test by certified Lab & Test Report Prepare																			

RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																				
1	TEMPERATURE RISE TEST	MODEL : LRS-150F-12 1. ROOM AMBIENT BURN-IN : 2 HRS I/P : 230VAC O/P : FULL LOAD Ta=27.2°C 2. HIGH AMBIENT BURN-IN : 2 HRS I/P : 230VAC O/P : FULL LOAD Ta=40.6°C																																																						
				<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 18.6°C</th> <th>HIGH AMBIENT Ta=42.1°C</th> </tr> </thead> <tbody> <tr><td>1</td><td>D6</td><td>66.2°C</td><td>77.9°C</td></tr> <tr><td>2</td><td>C6</td><td>67.4°C</td><td>76.7°C</td></tr> <tr><td>3</td><td>Q1</td><td>84.7°C</td><td>96.6°C</td></tr> <tr><td>4</td><td>C35</td><td>66.3°C</td><td>76.3°C</td></tr> <tr><td>5</td><td>BD1</td><td>86.4°C</td><td>95.7°C</td></tr> <tr><td>6</td><td>Q100</td><td>96.9°C</td><td>107.0°C</td></tr> <tr><td>7</td><td>C106</td><td>77.9°C</td><td>89.5°C</td></tr> <tr><td>8</td><td>LF1</td><td>65.6°C</td><td>76.5°C</td></tr> <tr><td>9</td><td>RTH10</td><td>75.4°C</td><td>86.7°C</td></tr> <tr><td>10</td><td>R14</td><td>73.7°C</td><td>86.1°C</td></tr> <tr><td>11</td><td>T1</td><td>82.4°C</td><td>92.4°C</td></tr> <tr><td>12</td><td>TA</td><td>27.2°C</td><td>40.6°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 18.6°C	HIGH AMBIENT Ta=42.1°C	1	D6	66.2°C	77.9°C	2	C6	67.4°C	76.7°C	3	Q1	84.7°C	96.6°C	4	C35	66.3°C	76.3°C	5	BD1	86.4°C	95.7°C	6	Q100	96.9°C	107.0°C	7	C106	77.9°C	89.5°C	8	LF1	65.6°C	76.5°C	9	RTH10	75.4°C	86.7°C	10	R14	73.7°C	86.1°C	11	T1	82.4°C	92.4°C	12	TA	27.2°C	40.6°C
NO	Position	ROOM AMBIENT Ta= 18.6°C	HIGH AMBIENT Ta=42.1°C																																																					
1	D6	66.2°C	77.9°C																																																					
2	C6	67.4°C	76.7°C																																																					
3	Q1	84.7°C	96.6°C																																																					
4	C35	66.3°C	76.3°C																																																					
5	BD1	86.4°C	95.7°C																																																					
6	Q100	96.9°C	107.0°C																																																					
7	C106	77.9°C	89.5°C																																																					
8	LF1	65.6°C	76.5°C																																																					
9	RTH10	75.4°C	86.7°C																																																					
10	R14	73.7°C	86.1°C																																																					
11	T1	82.4°C	92.4°C																																																					
12	TA	27.2°C	40.6°C																																																					
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 230 VAC O/P : 113% LOAD Ta : 25°C	TEST : OK																																																				
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 264VAC/100VAC O/P : 100% LOAD Ta= -30°C	TEST : OK																																																				
4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 40°C NO DAMAGE	I/P : 272 VAC O/P : FULL LOAD Ta= 40°C HUMIDITY= 95 %R.H	TEST : OK																																																				
5	TEMPERATURE COEFFICIENT	±0.03 %/°C (0~50°C)	I/P : 230VAC O/P : FULL LOAD	±0%/°C (0~40°C)																																																				
6	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -40°C ~ +85°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 5 CYCLE 5. Input/Output condition : STATIC		OK																																																				



7	THERMAL SHOCK TEST	1. Thermal shock Temperature : -20°C~ 70°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : 230VAC/Full Load AC ON/OFF TEST turn on 58sec ; turn off 2sec	OK
8	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 5G (5) Test Time : 60min in each axis (X.Y.Z) (6) Ta : 25°C	TEST : OK
9	CAPACITOR LIFE CYCLE	SUPPOSE C105 IS THE MOST CRITICAL COMPONENT (1) I/P : 230VAC O/P : FULL LOAD Ta= 25°C LIFE TIME (2) I/P : 230VAC O/P : FULL LOAD Ta=40°C LIFE TIME (3) I/P : 230VAC O/P : 75% LOAD Ta= 40°C LIFE TIME (4) I/P : 230VAC O/P : 50% LOAD Ta= 40°C LIFE TIME	(1) 81305HRS (2) 23047HRS (3) 48975HRS (4) 93362HRS
10	MTBF	2761.8K hrs min. Telcordia SR-332 (Bellcore) ; 592.4Khrs min. MIL-HDBK-217F (25°C)	
11	DMTBF/Accelerated Life Test	Demonstration Mean Time Between Failure (Expected Life): Above 30,000 hours @ TA 50°C	

TEST RESULT	TESTER	APPROVAL
PASS	FRANK	WANGDZ

2007/3/20 A50-S014